


**SECTION VIEW**

FOR PIPE SLOPES:  
LESS THAN OR EQUAL TO 15%

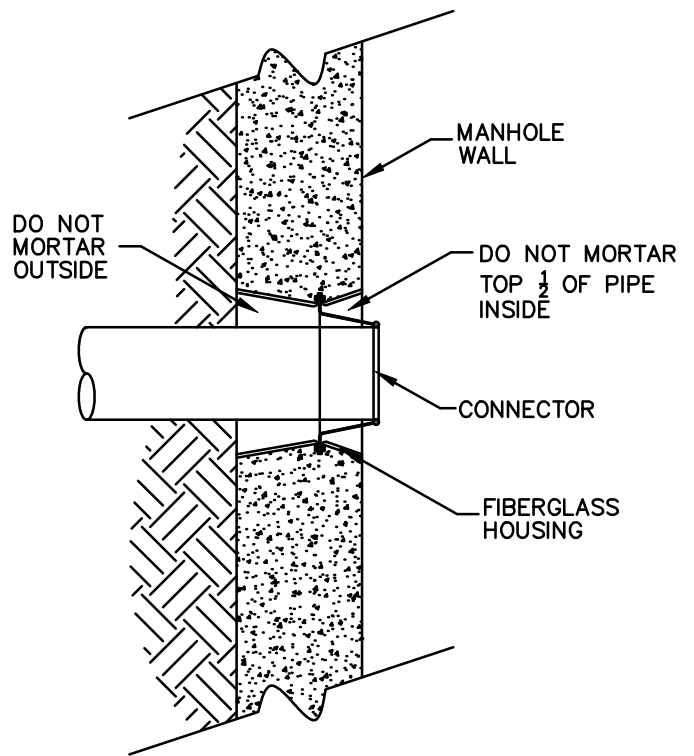

**SECTION VIEW**

FOR PIPE SLOPES:  
GREATER THAN 15%

**NOTES:**

1. FLEXIBLE CONNECTOR SHALL BE CAST INTO ALL PRECAST MANHOLES AND SHALL CONFORM TO ASTM C923.
2. PRECAST MANHOLE MANUFACTURER SHALL INSTALL CONNECTORS PER MANUFACTURER'S INSTRUCTIONS.



APPROVED

TRM  
CITY ENGINEER

5-25-22  
DATE

REVISED


CONNECTIONS TO NEW  
PRECAST MANHOLES

STANDARD  
DETAIL

31-5