


LEGEND

- A. - FLANGED TEE
- B. - RESILIENT SEATED GATE VALVE
- C. - WATER METER
- D. - FLANGED ADAPTER & PLAIN END BY FLANGED END PIPE

- E. - METER PIT LID
- F. - ACCESS MANHOLE
- G. - WALL PIPE
- H. - PIPE SUPPORTS

METER SIZE	MINIMUM LAY LENGTH. COMBINATION OF C & D.
3"	48"
4"	50"
6"	62"

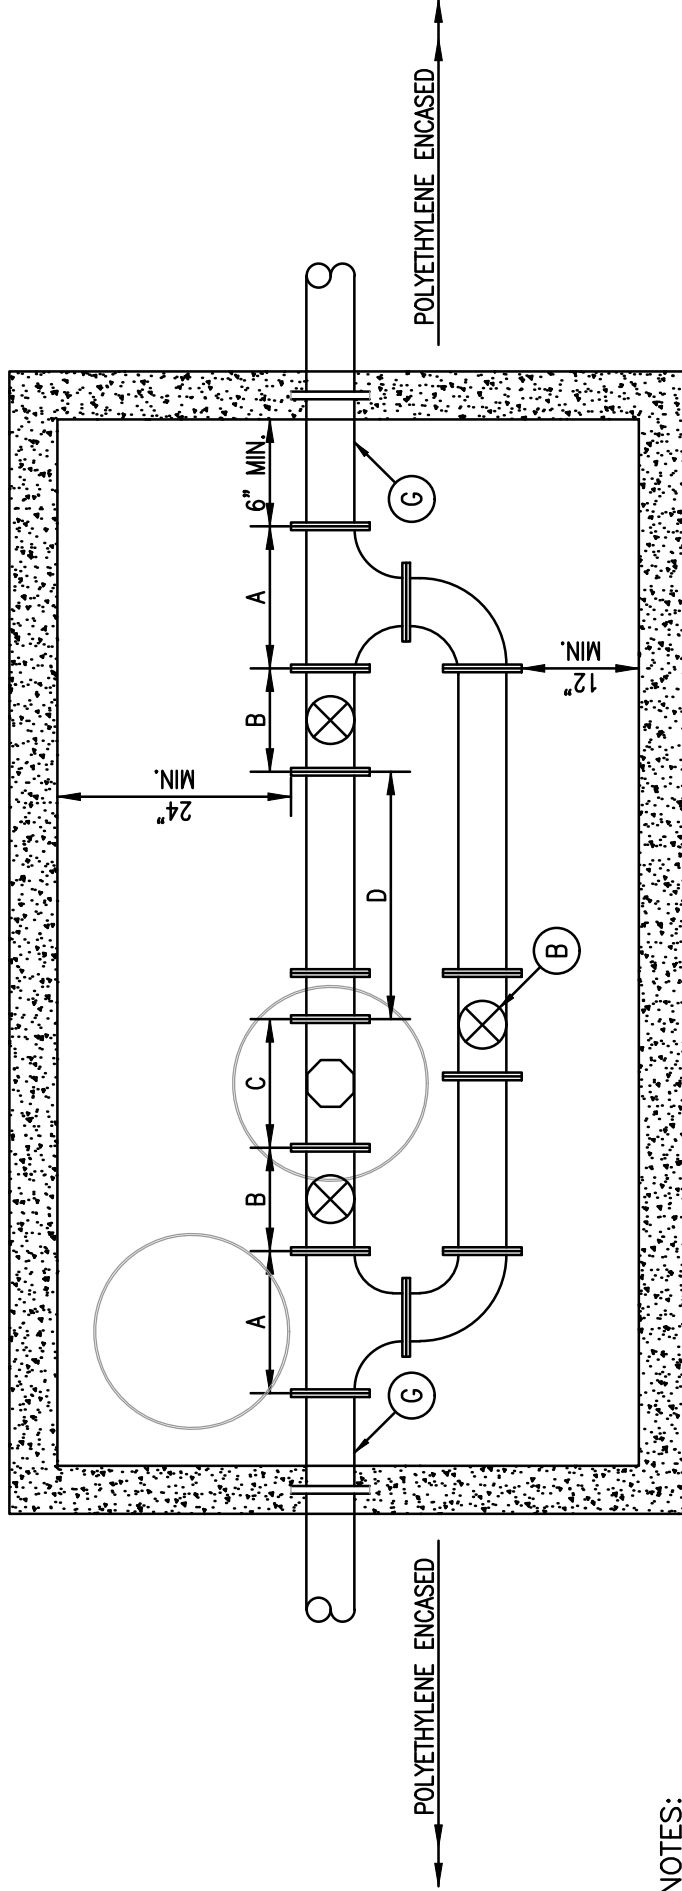

NOTES:

ALL WATER LINE PIPING SHALL BE POLYETHYLENE ENCASED, EXCEPT PIPING IN VAULT.

FURNISHED BY THE CITY OF GARDNER UTILITIES DEPARTMENT:

\*WATER METER

PLAN VIEW

	APPROVED	REVISED
	TRM CITY ENGINEER 5-25-22 DATE	_____ _____ _____

STANDARD DETAIL	3" TO 6" METER VAULT PIPING LAYOUT
51-6A	