



NOTES:

1. LIFTING EYES SHALL BE APPROXIMATELY 2' FROM EACH CORNER.
2. LID TO BE SEALED WITH BUTYL SEALANT

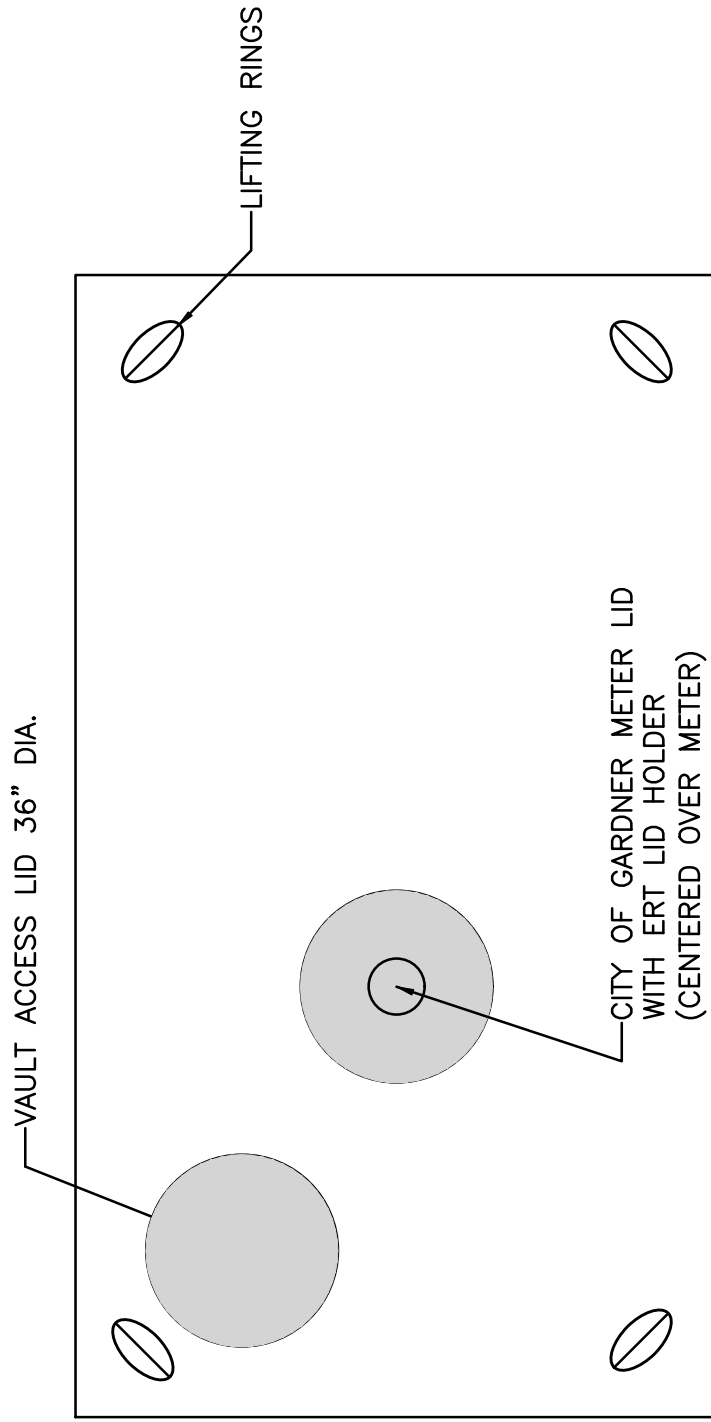

VAULT TOP - PLAN VIEW

	APPROVED	REVISED	3" TO 6" METER VAULT LID	STANDARD DETAIL 51-6C
	TRM CITY ENGINEER	_____ _____ _____		
	5-25-22 DATE			